




TYPICAL OVERHEAD RESIDENTIAL METER INSTALLATION

100-225A, 1 Ph, 3W, 120/240 VOLT



Permits and inspections are required. Please contact the governing inspection agency in your area and in the APS Electric Service Requirements Manual (ESRM).

This is a list of material for a normal overhead residential meter installation. It is not intended to be all inclusive but gives the more common requirements. All equipment shall comply with EUSERC requirements and all specifications found in the APS Electric Service Requirements Manual (ESRM).

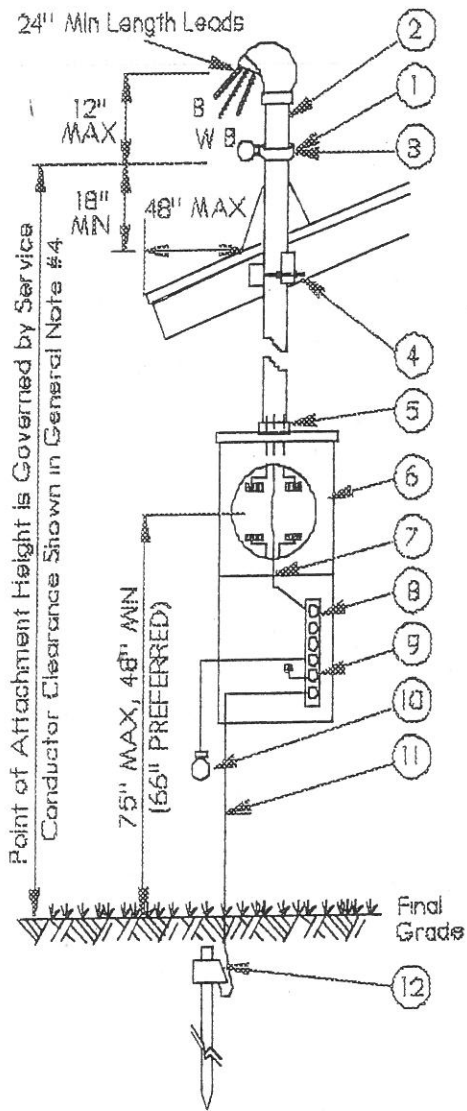

SERVICE RATING	COPPER	ALUMINUM	WEATHERHEAD & CONDUIT
100A	#4	#2	1-1/2"
125A	#2	#1/0	1-1/2"
150A	#1	#2/0	1-1/2"
200A	#2/0	#4/0	2"
225A	#3/0	#250	2" (2-1/2" if #250)

- 1) Point-of-attachment to be insulated. (ESRM 400.1)
- 2) Rigid metal conduit is required if service is attached to the service drop clamp. If conduit is attached to building, Customer is to install a 1/2" bolt with a 2" backing washer.
- 3) Unbraced point-of-attachment maximum height above roof is 20" for 1-1/2" conduit and 30" for 2" and larger conduit.
- 4) Universal service drop brace. (See reverse side for examples.)
- 5) Approved hub, must be raintight.
- 6) Meter socket, breaker panel must be raintight equipment. Meter socket jaws or clips shall be free of foreign material (mud, paint, plaster, etc.). RINGLESS METER SOCKETS ARE NOT ACCEPTABLE.
- 7) Neutral to be a continuous, unbroken conductor from the weatherhead to the neutral landing block.
- 8) Neutral landing block.
- 9) Install a bonding jumper or screw if the neutral landing block is insulated from the enclosure.
- 10) Bonding of piping systems - all interior metal piping shall be bonded to the electric grounding system. Gas piping shall be bonded on the house side of the insulating coupling.
- 11) The ground wire (#4 bare solid copper) shall be continuous from the neutral landing block to an approved grounding electrode system in compliance with NEC Article 250. The ground wire must be properly supported and attached to the building at 24" intervals.
- 12) Approved grounding electrode system.
 - a) 5/8" x 8' long ground rod and approved clamp. Entire length of rod to belowgrade.
 - b) 20' of bare #4 copper wire installed in concrete footer (UFER).

Note: Enough wire to reach main disconnect enclosure must extend outside concrete footer.

GENERAL NOTES:

1. Meter location to be specified by Company Representative
2. If more than one meter to the premise - each meter shall be permanently identified, by the Customer, to properly identify that portion of the premises being served. Metal stamping or metal tag is required. Painted identification is not acceptable.
3. All materials or work furnished by the Customer shall be in accordance with all applicable codes or standards.

4. Minimum service height above ground:	
Over areas accessible to pedestrians	12' 6"
Crossing over residential driveways	12' 6"
Over parking lots, service areas & open driveways not subject to truck traffic	12' 6"
Over parking lots, service areas & open driveways subject to truck traffic	18'
Over public streets, alleys or roads in urban or rural districts	18'
Over areas accessible to equestrian traffic	18'